


## DUCT SMOKE DETECTOR

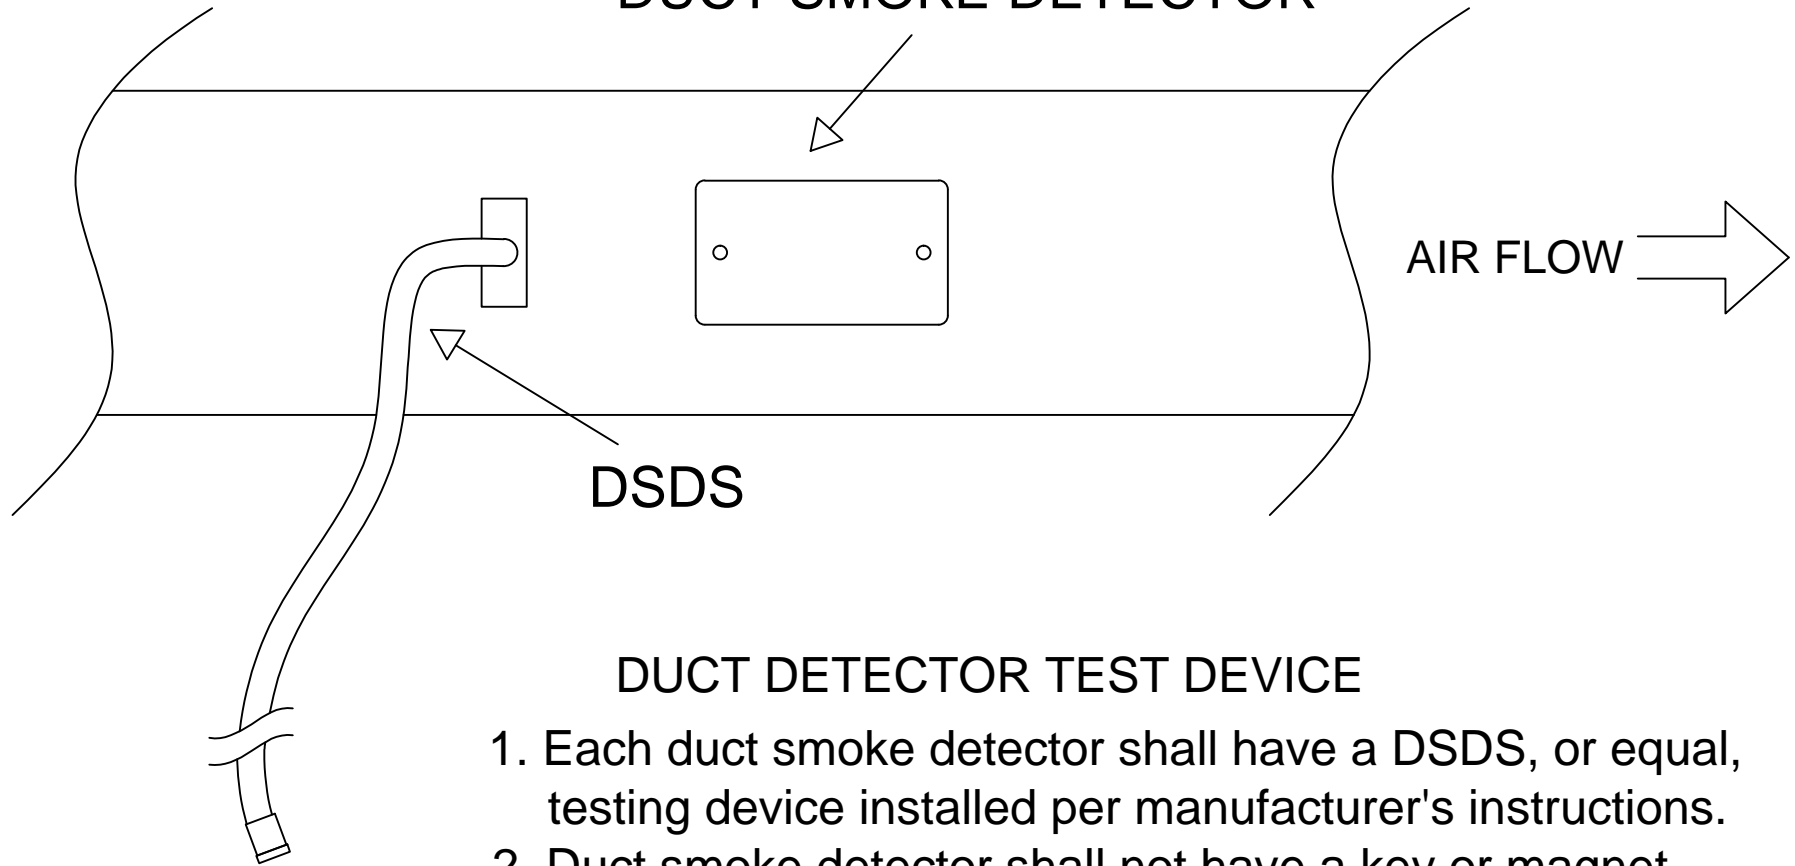

## DUCT DETECTOR TEST DEVICE

1. Each duct smoke detector shall have a DSDS, or equal, testing device installed per manufacturer's instructions.
2. Duct smoke detector shall not have a key or magnet operated test device.
3. Each duct smoke detector shall have a remote alarm annunciator installed per local building code.
4. DSDS device available from [lifesafetytest.com](http://lifesafetytest.com)